


Brushing Requirements

FOR SECONDARY 120/240 VOLT LINES

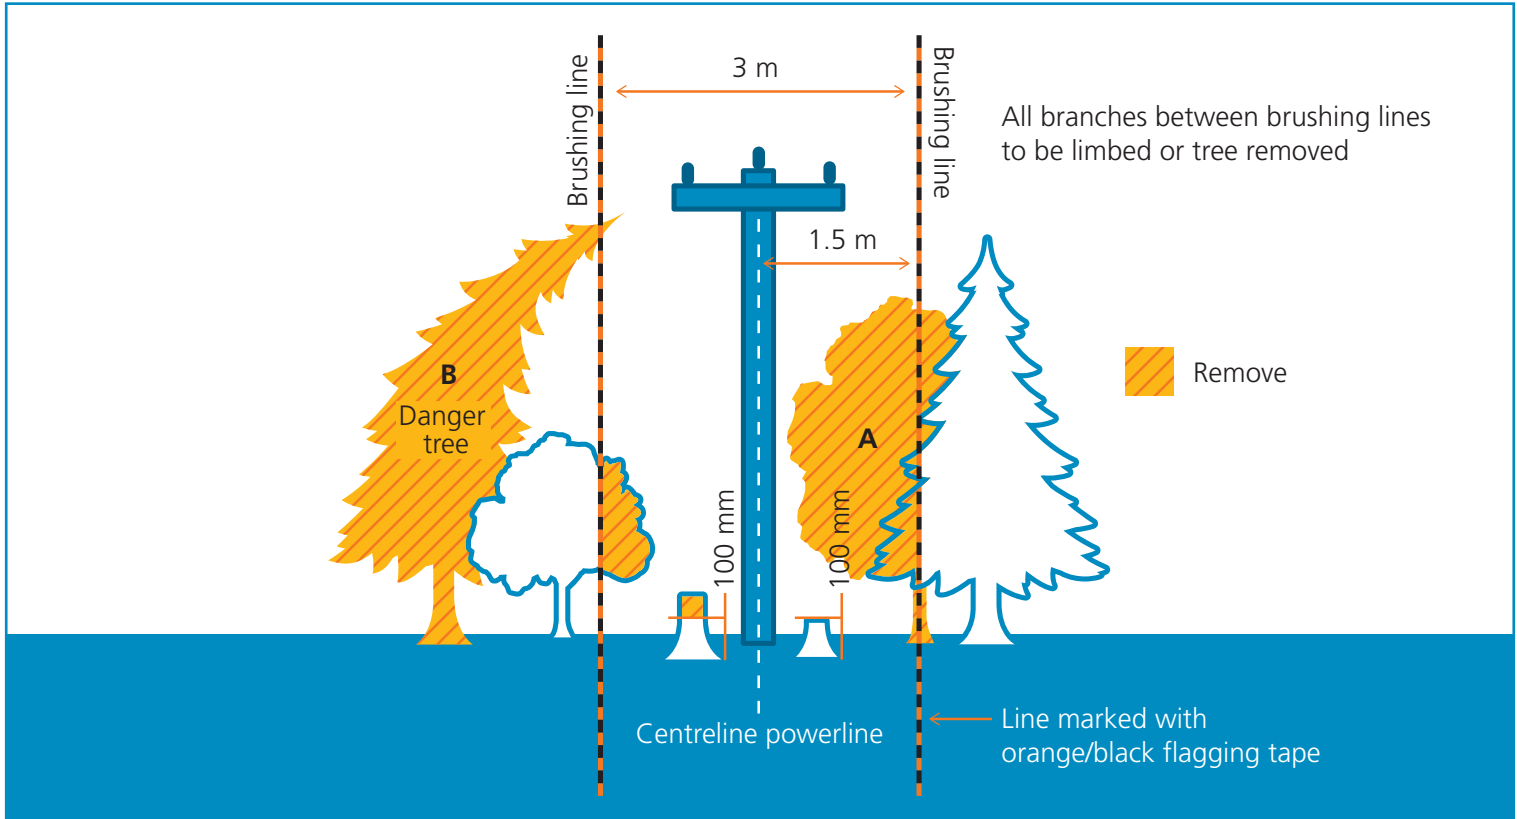

- 1) All trees, limbs, deadfall and brush are to be removed between brushing lines indicated with orange with black striped flagging.
- 2) Limbing must be completed to the top of trees at the brushing line or the tree must be removed.
- 3) The customer has the option of aerial trimming on the tree (see tree A in diagram). This service can be provided by the construction crew at an approximate cost to the customer of \$275/hr. This extra charge is not included in the construction estimate. If the customer does not accept this option, Tree A must be removed.
- 4) All stumps are to be cut flush or as close as possible to the ground (they must not exceed 100 mm from ground level).
- 5) All trees leaning toward the brushed right of way are considered 'danger trees' and must be removed (see tree B in diagram).
- 6) All dead or rotting trees adjacent to the right of way must be removed.
- 7) All flagging done on site indicates absolute minimum brush removal; the right of way is to be cleared of all vegetation and obstacles that are incompatible with the operation of an electrical system.