




# Danger

## MINIMUM REQUIREMENTS FOR UNQUALIFIED WORKERS AND/OR EQUIPMENT OPERATING NEAR UNDERGROUND CABLES

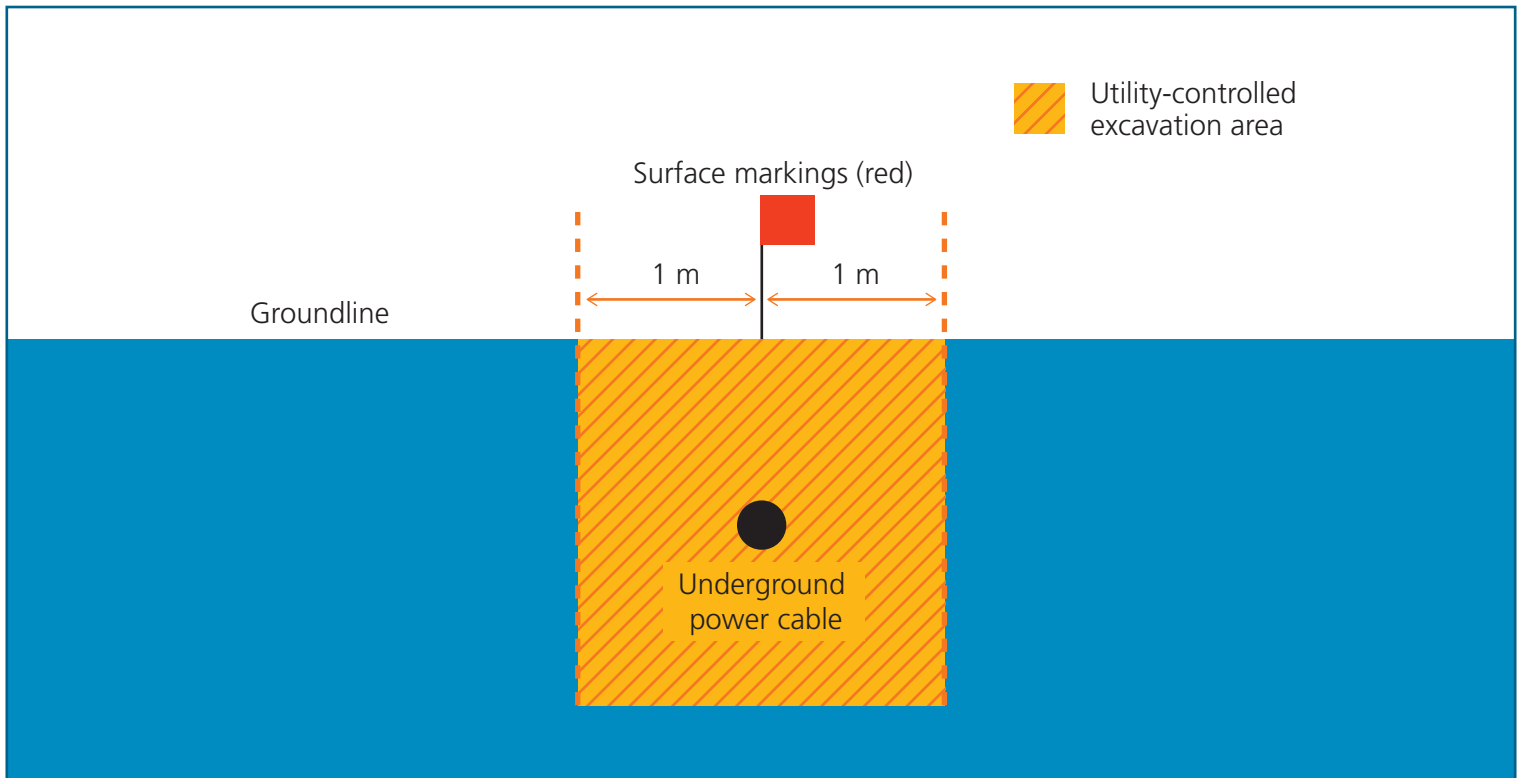

**Purpose:** These minimum requirements are for your protection and safety. Contact with underground power cables is extremely dangerous and could result in death.

- 1) You must **CALL BEFORE YOU DIG** to ascertain whether underground power cables are located at or near the excavation site. For **Yukon Energy** service areas call 1-800-676-2843. For other underground facilities, contact the operator of the facility.
- 2) Prior to any ground disturbance or excavation activity, **Yukon Energy** will identify and mark any underground cables that are located near the utility-controlled excavation area.
- 3) The person responsible for an excavation must make sure that no excavation work is undertaken within **1 m** of any underground power cables unless:
  - a) the excavation work is done under the control of **Yukon Energy**, and
  - b) the excavation work method is approved by **Yukon Energy**.

**If you accidentally dig into an underground power cable in a Yukon Energy service area, stay clear and call 1-800-676-2843.**

